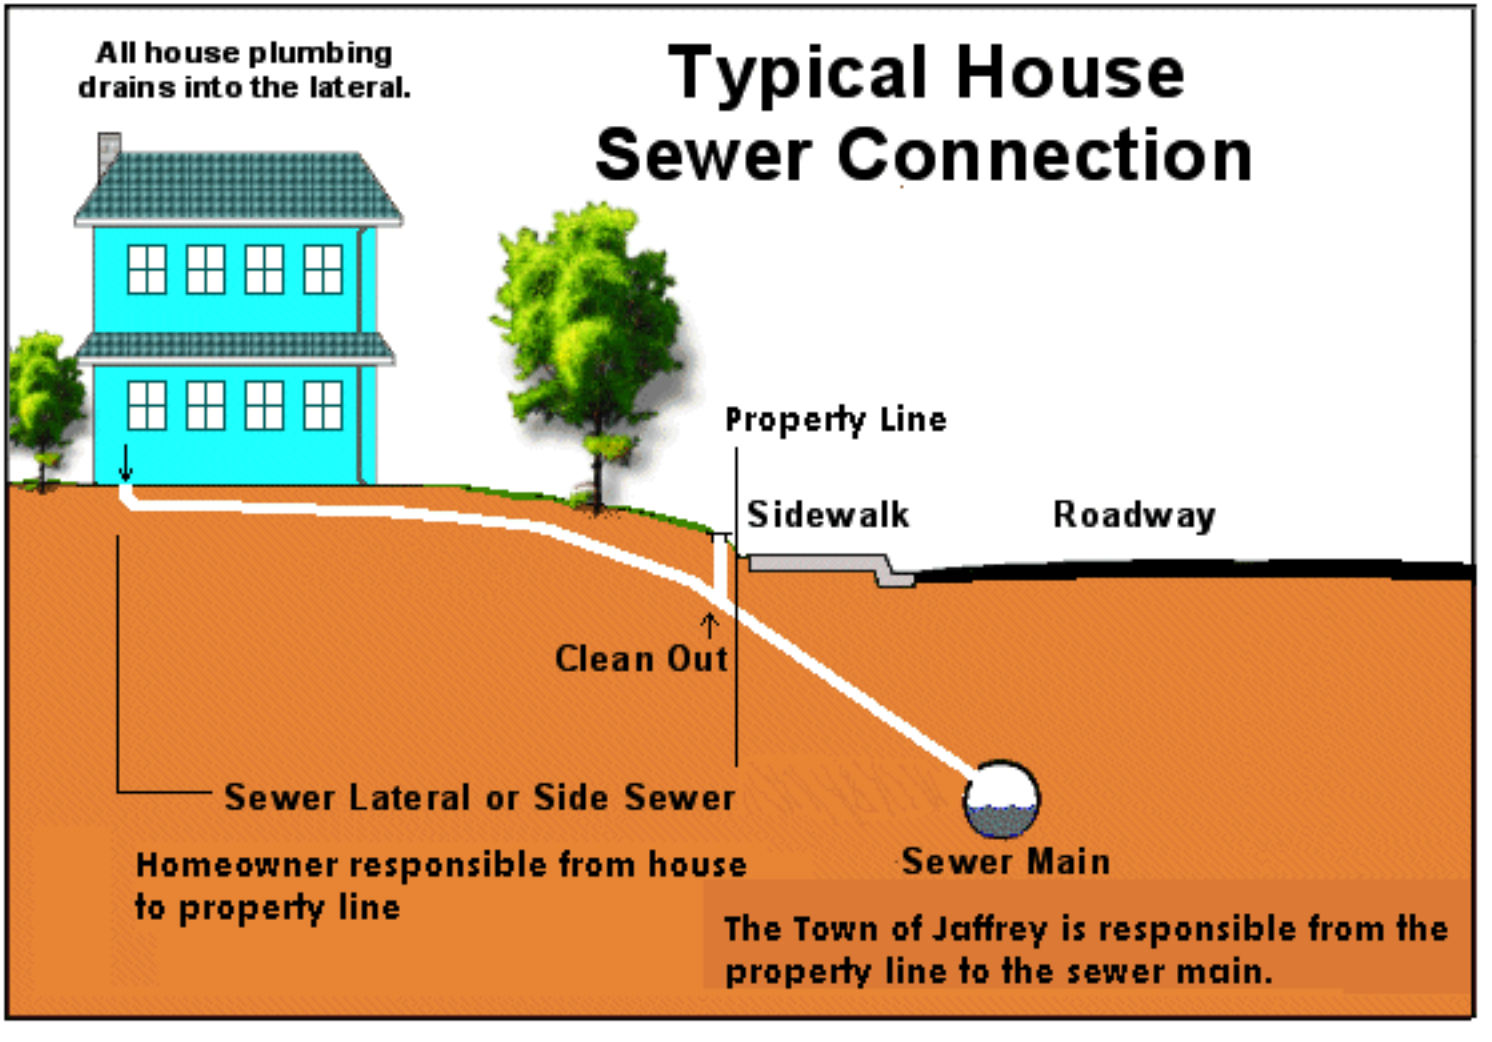

Sump pump connections should not be discharged into the sewer system.